

INVERTER GENERATOR USER'S MANUAL





GM11000IET 11000 WATTS 8500 WATTS

TRI-FUEL INVERTER GENERATOR









WARNING: SAVE THIS MANUAL FOR FUTURE REFERENCE



This manual contains important information regarding safety. Operation, maintenance and storage of this product. Before use, read carefully and understand all cautions, warnings, instructions and product labels. Failure to do so could result in serious personal injury and/or property damage.



The engine exhaust from this product contains chemicals known to the state of California to cause cancer, birth defects or other reproductive harm.

California Proposition 65 Warning

Certain components in this product and its related accessories contain chemicals known to the state of California to cause cancer, birth defects or other reproductive harm. Wash hands after handling.

DISCLAIMERS:

All information, illustrations and specifications in this manual are based on the latest information available at the time of publishing. The illustrations used in this manual are intended as representative reference views only. Moreover, because of our continuous product improvement policy, we may modify information, illustrations and/or specifications to explain and/or exemplify a product, service or maintenance improvement. We reserve the right to make any change at any time without notice. Some images may vary depending upon which model is shown.

ALL RIGHTS RESERVED:

No part of this publication may be reproduced or used in any form by any means - graphic, electronic or mechanical, including photocopying, recording, taping or information storage and retrieval systems - without the written permission of CHONGQING DINKING POWER MACHINERY CO., LTD

A DANGER



This manual contains important instructions for operating this inverter generator. For your safety and the safety of others, be sure to read this manual thoroughly before operating the generator. Failure to properly follow all instructions and precautions can cause you and others to be seriously hurt or killed.

UNPACKING

CAUTION



Always have assistance when lifting the generator. The generator is heavy; lifting it could cause bodily harm.



Avoid cutting on or near staples to prevent personal injury.

Tools required - box cutter or similar device.

- 1. Carefully cut the packing tape on top of the carton.
- 2. Remove socket wrench, and oil funnel and save for later.
- 3. Carefully cut two sides of the carton to remove the generator.

WHAT COMES IN THE BOX

Spark Plug Socket Wrench (1)

Dual-Purpose Screwdriver (1)

Owner Manual (1)

Warranty Information (1)

Funnel (1)

NEMA L14-30P Bonding Plug (1)

LPG Hose (1)

NG Hose (1)

NG Quick Connector (1)

Battery Charger (1)

Engine Oil (1)

Remote Control Key (1)

DESCRIPTION OF FITTINGS

Spark Plug Socket Wrench




Used in spark plug maintenance, inspection, and installation.

Dual-Purpose Screwdriver



Phillips and slot blade screwdriver used for generator maintenance.

Funnel



It's used to oil the generator.

Remote Control Key



Used to remotely start and stop the generator.

Battery Charger



Used to charge the battery when in storage.

Engine Oil




Be sure to add oil before starting the generator.

NEMA L14-30P Bonding Plug




Insert the Bonding Plug into the output socket of the generator to change the neutral floating to neutral bonded status.

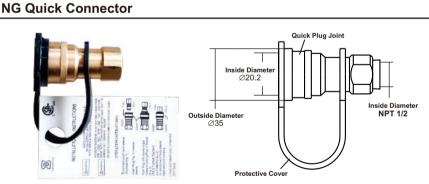


Used to change a natural gas pipeline interface.

Note: Actual tools may differ in appearance or design from image shown.



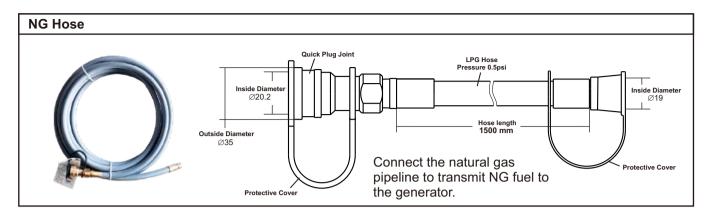

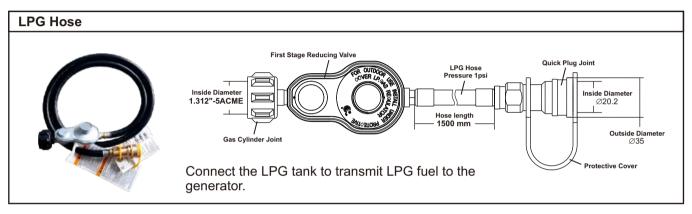

Note: Actual tools may differ in appearance or design from image shown.

LIMITED WARRANTY

- 1. DURATION : One (1) year from the date of purchase by the original purchaser (retail customer) on products used solely for consumer applications; if a product is used for business, commercial, or industrial applications, the warranty per iod will be limited to ninety (90) days from the date of purchase.
- 2. WHO GIVES THIS WARRANTY (WARRANTOR):
 - CHONGQING DINKING POWER MACHINERY CO., LTD
- 3. WHO RECEIVES THIS WARRANTY(PURCHASER): The original purchaser (other than for purposes of resale) of the Genmax's inverter.
- 4. WHAT PRODUCTS ARE COVERED BY THIS WARRANTY: Any portable generator supplied or manufactured by Warrantor.
- 5. WHAT IS COVERED UNDER THIS WARRANTY: Substantial defects on material and workmanship which occur within the duration of the warranty period.
- 6. WHAT IS NOT COVERED UNDER THIS WARRANTY:
 - A. Transportation changes for sending the product to Warrantor or its authorized service representative for warranty service, or for shipping repaired or replacement products back to the customer; these charges must be borne by the customer.
 - B. Damages caused by abuse, accident, shipping, misuse, overloading, modification, and the effects of corrosion, erosion and normal wear and tear.
 - C. Warranty is voided if the customer fails to install, maintain and operate the product in accordance with the instructions and recommendations set forth in the owner's manual(s), or if the product is used as rental equipment.
 - D. Pre-delivery service, i.e. assembly, oil or lubricants, and adjustment.
 - E. Items or service that are normally required to maintain the product, i.e. lubricants and filters.
 - F. Warrantor will not pay for repairs or adjustments to the product, or for any costs or labour, performed without Warrantor's prior authorization.

EXCLUSIONS AND LIMITATIONS: Warrantor makes no other warranty of any kind, express or implied. Implied warranties, including warranties of merchantability and of fitness for a particular purpose, are hereby disclaimed. This warranty service described above is the exclusive remedy under this warranty; liability for incidental and consequential damages is excluded to the extent permitted by law.

- 7. RESPONSIBILITIES OF PURCHASER UNDER THIS WARRANTY:
 - A. The purchaser must provide dated proof of purchase and must notify Warrantor within the warranty period.

Phone: 866-960-2920

- B. Deliver or ship the serviced generator or component to the nearest Warrantor's authorized service representative. Freight costs, if any, must be borne by the purchaser.
- 8. HAVE QUESTIONS?

Email: service@genmaxpower.com

00	•
	WARRANTY CARD

PERSONAL INFORMATION	INVERTER INFORMATION
Name:	Model Number:
Street Address:	Serial Number:
City, State, ZIP:	Date Purchased:
Country:	Purchased From:
Phone Number:	GENMAX ®
E-Mail:	

TABLE OF CONTENTS

LIMITED WARRANTY	4
SAFETY WARNING	6
SAFETY INSTRUCTIONS	7
NAMES OF COMPONENTS	9
CONTROL FUNCTIONS	10
PREPARATIONS	14
1.Fuel	14
SHUTTING DOWN THE GENERATOR	21
USING THE GENERATOR	22
1.Service Environment of the Generator	22 23 24
SERVICE AND MAINTENANCE	25
1.Spark Plug Inspection	27 27 28 28
STORAGE AND TRANSPORT	30
1.Generator Storage 2.Generator Transport 3.Preparation for Use After Storage	31
TROUBLESHOOTING	32
TECHNICAL PARAMETERS	34
CHOOSING A GENERATOR	35

+

SAFETY WARNING





Personal and property safeties of you and others are very vital. Please read the Safety Warning in the User's Manual and the decals of the generator set carefully. The Safety Warning can alert you to those potential hazards that could harm you and others. In front of each Safety Warning, there is one of four words "DANGER" "WARNING", "ATTENTION", and "CAREFUL". Details are as follows:

DANGER

Failure to follow the instruction will result in being in peril of your life or extremely serious injury.

CAREFUL

Failure to follow the instruction will result in minor injury.

WARNING

Failure to follow the instruction will result in being in peril of your life or very serious injury.

ATTENTION

Failure to follow the instruction will result in the damage to your generator set and other properties.

CO TECHNICAL WARNING

CO DETECT technology monitors the accumulation of carbon monoxide (CO), a poisonous gas produced by engine exhaust when the generator is running. If CO Sensor detects unsafe elevated levels of CO gas, it automatically shuts off the engine. CO Sensor is not a substitute for an indoor carbon monoxide alarm or for safe operation. DO NOT allow engine exhaust fumes to enter a confined area through windows, doors, vents or other openings. Generators must ALWAYS be used outdoors, far away from occupied buildings with engine exhaust pointed away from people and buildings. Meets the requirements of ANSI/PGMA G300-2018.

NEUTRAL FLOATING

For portable generators where the neutral is floating, the operator's manual shall include the following wording or equivalent:

The portable generator stator winding is isolated from the frame and from the AC receptacle ground pin; and Electrical devices that require a connection between one conductor pin and the grounded receptacle pin may not function properly.

SAFETY INSTRUCTIONS

Before operating the generator, it will help you avoid accidents to read and understand the Manual and familiarize yourself with the safe operation procedures of the generator.





Please do not use in humid environment










SAFETY INSTRUCTIONS

SAFETY LABELS AND DECALS

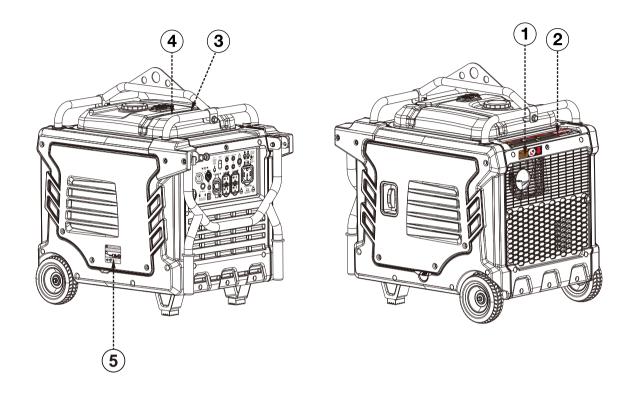






















NAMES OF COMPONENTS










- ① Fuel Tank Cap: Open the fuel tank cap and fill with proper amount of gasoline.
- 2 Recoil Handle: Pull to start the engine.
- 3 Fuel Tank: Store the added gasoline.
- **4 Left Outer Cover:** Unscrew the bolt, remove the outer cover, connect the battery wire, maintain the air filter and replace the spark plug.
- **⑤ Control Panel:** Contains the reset breaker, outlets and warning lights.
- **(6)** Engine Cooling Vents: Helps move airflow in unit to regulate engine temperatures.

- Right Outer Cover: Unscrew the bolts, remove the outer cover, and add or change the oil.
- **® Muffler:** Avoid contact until the engine is cooled down. The spark arrestor prevents sparks from exiting the muffler. It must be removed for servicing.
- Wheel
- **10 Handrail**
- **11 Lifting frame**



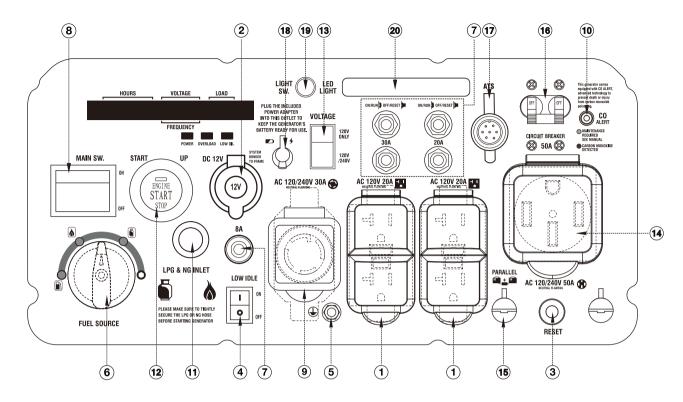

CONTROL PANEL FEATURES GM11000iET


- ① 120V AC 20A 5-20R Outlet: The outlet is capable of carrying a maximum of 20 amps.
- ② DC Cigarette Lighter Outlet: 12V DC 8.3A.
- ③ Reset: If the generator is overloaded, the reset breaker will trip. The engine will continue to run, but there will be no output from the generator. Unplug the devices and reduce the load. Push in the reset breaker to reset it.
- **(4)** Low Idle: When turned to the ON position, the engine will sense the load needed and run at a slower RPM to save fuel.
- **⑤ Ground Terminal:** The ground terminal is used to externally ground the generator.
- 6 Fuel Source Switch: Choice of fuel source.
- ② AC Breaker: If the inverter is overloaded, the reset breaker will trip to block current.
- (8) Main Switch: Manage battery power and shutdown. *Tip: If* you do not use the generator for more than 7 days (168 hours), please press the main switch to the "OFF" position, which can prevent the battery from running out.
- 120/240V AC 30A L14-30R Outlet: The outlet is capable
 of carrying a maximum of 30 amps.
- **@ CO Alarm:** Shuts down the engine in the event of CO buildup.
- ① **LPG Inlet**: Connects the LPG inlet to the LPG hose/regulator.
- ② One Push Start: Press this button, the engine can start and stop.
- Voltage Switch: Switch between 120V and 240V voltage as required.

- 4 120/240V AC 50A 14-50R Outlet: Receptacle can supply a maximum of 50 Amps.
- (§) Parallel Connectors: To increase AC power output, the connector sockets are used to connect the two same type generators with special parallel cable GM9000PK sold by GENMAX. The connector sockets is only used to connect two inverter generators. They can not used for AC power output. The special parallel cable GM9000PK shall be purchased separately, and they shall be approved by certification body.
- **© Circuit Breaker:** A circuit breaker interrupts the current when the whole circuit is overloaded.
- (7) ATS Interface: For connecting to ATS control box.
- ® Battery Charging Port: Charge the generator battery.
- Light Switch: Press first to turn on the LED light and second to turn off the LED light.
- ② LED Light: 1. The LED light can be used normally when the generator is running, and the LED light cannot be used when the generator shuts down.
- 2. If the LED light is not turned off, press the one-key start button (or remote control key) to stop the generator while the main switch is not turned off, the LED light will automatically turn off after 30 seconds.
- 3. Press the one-key start button (or remote control key) to stop the generator and also turned off the main switch, the LED light will go out immediately.






OUTPUT DESCRIPTION OF THE AC SOCKET

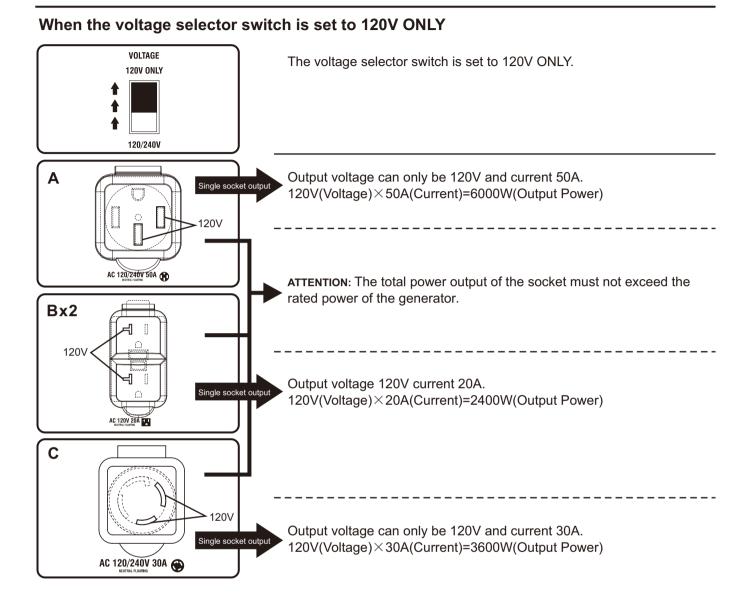






When the voltage selector switch is set to 120/240V (Suitable for parallel)

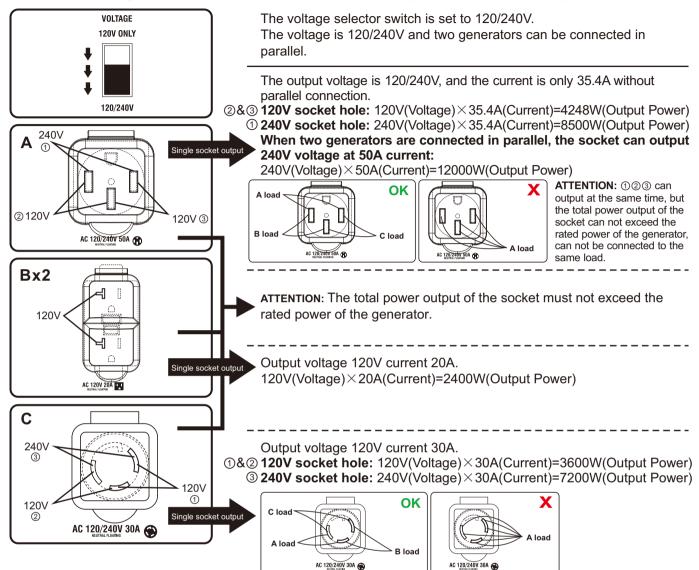

ATTENTION: ①②③ can output at the same time, but the total power output of the socket can not exceed the rated power of the generator, can not be connected to the same load.


_

DIGITAL DISPLAY CENTER

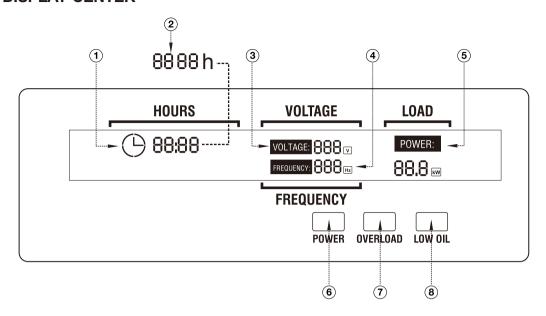

- ① \bigcirc 88.88 Represents single run time, goes from 0 at each startup.
- ② 8888 in Represents total operation time of the generator.(*Tip: The total operation time shall start to accumulate after the generator runs for one hour. It will not be displayed when the generator runs for less than one hour. The total operation time shall be accumulated by hours.*) The two factors ① and ② are displayed alternately every 8 seconds.
- ③ VOLTAGE: Voltage display: 120V and 240V switch every 16 seconds.
- 4 FREQUENCY: Frequency display.
- (5) LOAD: Load power display.
- 6 POWER: Green light means normal operation.
- ⑦ OVERLOAD: Red light means the machine overload.
- ® LOW OIL: Red light means the amount of oil is too low.

WORKING MODE OF THE ATS SOCKET



ATS SOCKET

Number	Connection Function
1	Battery Charge +12V
2	Ground
3	Engine Start
4	Emergency Stop
5	Not Connected
6	Engine Running
7	Not Connected





2/3 are for start and stop the generator 2/4 are for emergency shutdown the generator.

PREPARATIONS



1 Fuel



DANGER

- Fuel is flammable and toxic, please read the Safety Instruction carefully before refueling;
- Do not fuel too full, otherwise fuel will spill after fuel tank is warmed;
- After refueling, confirm that the fuel tank cap has been tightened.



ATTENTION

- After refueling, dry gasoline residue with a clean and soft cloth in time to avoid damaging plastic enclosure;
- Unleaded gasoline must be used, as leaded gasoline can seriously damage internal parts of the generator;

Remove fuel tank cap, and add gasoline to red horizontal indicating line oil level. **Fuel tank capacity: 6.9gal (26L)**



2 Oil

No oil is filled into this generator when being delivered. Do not start up the generator without filling sufficient oil.

- 1. Please place the generator onto a horizontal plane surface;
- **2.** Open the right exterior cover, unscrew oil dipstick;





3. Fill in 0.3gal(1.1L) oil (SAE 10W/30 oil is recommended, of which the grade is API standard Type SE or higher);





4. Cover the right panel.



PREPARATIONS



3 Pre-use Inspection



WARNING

Even if the generator is not in service, its important component may suddenly fails. Before the generator is started up, if any of following components is unable to work properly, please inspect and repair carefully.

Tip: The condition of the generator shall be inspected before using every time.

Pre-operation inspection

Project	Possible Causes	Probable Solutions
Fuel	Check fuel level in fuel tank of the generator.	Add fuel if necessary.
Cil	Check oil level of the generator.	Add oil if necessary.
Oil	Check whether there is oil leaking.	
Abnormal conditions during operation	Check operating condition of the generator.	If there is any need, please do not hesitate to consult your dealer.
Battery	Check whether the battery is full.	See the "Battery Charging" page.

- Remove the load from all output ends;
- **2.** Connect battery line before first use:
 - 1. Remove the left panel cover;
 - 2. A guick-connect battery plug is pre-installed on the battery. Remove the cable tie securing the plugs, align colors, then push firmly to connect them.





3. Select the Fuel:



a. Gasoline: Turn the Fuel Source Switch to gasoline.





b. LPG:

- 1. Connect the LPG hose to the LPG tank;
- 2. Push back the quick connector sleeve of the LPG hose, insert the LPG/NG inlet, loosen the quick connector sleeve, and make the sleeve clamp the LPG/NG inlet;
- 3. Turn the Fuel Source Switch to LPG.












c. NG:

- 1. Screw the gas pipe adapter onto the gas pipe;
- 2. Push the quick connector sleeve backward, insert the NG hose, then loosen the quick connector sleeve, and make the sleeve clamp the hose joint;
- 3. Push back the quick connector sleeve of the NG hose, insert it into the LPG/NG inlet, loosen the quick connector sleeve, and make the sleeve clamp the LPG/NG inlet;
- 4. Turn the Fuel Source Switch to NG.



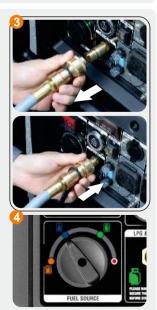

4. Press the LOW IDLE Switch to "OFF";



5. Press the Main Switch to "ON";



- **6.** Select Boot Mode:
 - a. Recoil Start: Pull the starting handle to start the generator.
 - b. Button Start: Press the button to start the generator.
 - c. Remote Start: Press the "START" button on the remote control to start the generator.







7. Plug in after started.



Remote Control Pairing

- 1. Long press the start button for more than 5 seconds until the button red indicator is on;
- 2. Press any key on the remote control;
- 3. The red indicator of the start button will blink two or three times and then turns off, Remote start pairing is successful.

Tip: The remote control delivered with the generator has been paired successfully.





Remote Control Key Dormancy

When generator stops running for 5 days (120hours), while the main switch is not turned off, the remote control key cannot be used to start the generator again. At this time, you need to turn off the main switch and turn it on again, or press the one-key start button (or hand start) to start the generator, and the remote control key will be reactivated.

COMMON PROBLEMS WITH STARTING THE GENERATOR:

Start the generator to run normally without output?

(1) Check whether the green light of the GFCI socket is on.

If the green light is not on, press the RESET button after the generator is started to make the green light on.

Tip: When the generator is not started, the GFCI socket is in the protected state and the "RESET" button cannot be pressed.

(2) Check whether the circuit breaker switch is set to "ON".
If the circuit breaker switch is set to ON and there is no output, press the heat protection corresponding to the socket and use a multimeter to test whether the socket has voltage.





LPG startup is difficult?

When both gasoline and LPG(or NG) are present in the generator it is recommended to start the generator on gasoline first, allow the engine to stabilize then switch to LPG(or NG).

1. Ensure the LPG (or NG) supply hose is securely attached and Close the LPG (or NG) valve completely.




- 2. Fuel source rocker switch to "GASOLINE".
- 3. Follow the startup steps to start the generator.



4. Open the LPG (or NG) valve completely.



5. Fuel source switch to "LPG (or NG)".



Electric start and remote start no response?

- 1. Check whether the positive and negative electrodes of the battery are correctly connected.
- 2. Check whether the battery is charged.
- 3. Check whether the remote control is powered on.







DANGER

Fire and explosion hazard. Always turn the propane tank (or methane) valve to the fully closed position if not running the generator on propane(or methane).



WARNING

When using the generator with propane(or methane), make sure there is no possible ignition source close to the generator.

Parallel Operation

The parallel connection ports allow you to connect two generators to increase the total available electrical power. Follow the instructions included with your parallel connection kit for proper installation and operation.

Overload Indicator

Note: The OVERLOAD light may turn on for a few seconds as a large device starts. This is normal for loads approaching the capacity of this generator.

- 1. The total combined load through the outlets on the generator must not exceed the running power of the unit.
- 2. If the OVERLOAD light turns on and the generator stops producing power, it has been overloaded.
- 3. Turn off and disconnect all electrical devices and stop the engine. Compare device requirements to generator rating and reduce the total wattage of connected devices if necessary. Move anything that may be limiting generator ventilation away.
- 4. Check if any circuit breakers have tripped and make sure that ALL circuit breakers are reset before starting the generator again.
- 5. Restart the engine and reconnect devices while being careful to not overload the generator.

Low Oil Indicator

- 1. If the engine oil level is too low, the LOW OIL light turns on and the engine will automatically shut off.
- 2. The engine cannot be restarted until the proper amount of oil has been added. Add the appropriate type of oil until the oil level is at the proper level. SAE 10W-30 oil is recommended for general use.

ATTENTION

Do not run the engine with too little oil. Engine will shut off if engine oil level is too low.

Low Idle

- 1. Turn on a Low Idle Switch to limit noise and fuel consumption with a light generator load.
- 2. Turn off the low idle mode to run the engine at full speed under the following conditions:
- Starting the generator.
- If the load exceeds 50%, it is recommended to turn off the low idle mode.

Voltage Selector

The Voltage Selector allows more current to be available at 120V outlets if 240V output is not required:

- Switch to 120V only: 120V sockets and 120V/240V dual voltage sockets can be used, but 120V/240V dual voltage sockets can only output 120V.
- Switch to 120V/240V: Both 120V and 240V outlets can be used.


NOTE: Do not change the switch while under load. For parallel function, switch position must be at 120/240V.



INVERTER PARALLEL KIT OPERATION

50A Parallel Kits


This parallel kit is intended to be used only with GENMAX inverter generators. Please read safety information below before proceeding.

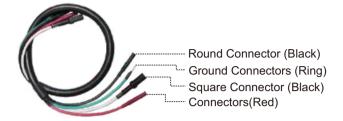

- 1. Make sure both engine switches are in the off position, and confirm the Low idle switches on both generators are turned off.
- 2. Attach the ground terminal (green wire) from each end of the parallel cable to the corresponding ground terminal on each generator. Connect and tighten the ground wire.
- 3. Connect the black and red parallel cable leads to the black parallel ports on each corresponding inverters control panel. **DO NOT connect two red leads or two black leads into the same inverter.** Pay attention: The white wire leave as it is, this just needed when parallel two GM9000i.
- 4. Connect the black square connector to the square socket of the generator.
- 5. Start each generator and confirm that the green output indicator is illuminated on both.

Tip: When two generators are connected in parallel, the voltage selector switch must be placed at 120/240V before starting.

- 6. If using Low idle mode, turn both Low idle switches on after the generators are started.
- 7. To shut down, turn off both generators and then remove the parallel cords.

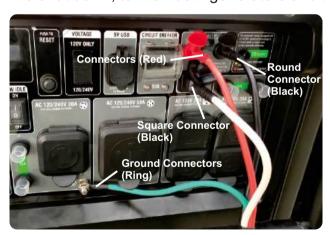

NOTICE: If high electrical loads are connected, turn the Low idle switch to the OFF position to reduce voltage changes. With the generators running, make sure both green output indicator lights are ON. If not ON, turn the generators off, restart the generators, and make sure both green output lights are ON.

SHUTTING DOWN THE GENERATOR

- **1.** Unplug the power cord;
- 2. Select Stop Mode:
 - a. Button Stop: Press the button to turn off the generator.
 - b. Remote Stop: Press the "STOP" button on the remote control to turn off the generator.





3. Press the Main Switch to "OFF";



4. Set the Fuel Source Wwitch to the off position.



IMPORTANT NOTES

The above instructions for starting and stopping the generator are normal procedures. Users must follow standard procedures to start, use and shut down the generator.

- If the user directly turns off the generator with the main switch, there may be a sound of muffler blasting, which is a normal phenomenon under abnormal operation.
- 2. When the battery is not connected or the battery is out of charge, if the user directly turns off the generator with the main switch, it may be difficult or impossible to start the cold machine, which is a normal phenomenon under abnormal operation.



-

USING THE GENERATOR

1 Service Environment of the Generator

- Applicable temperature: 23°F~104°F (-5°C~ 40°C);
- Applicable humidity: below 95%;
- Applicable altitude: regions below 1,500 m (It shall be used by reducing power in regions above 1,000 m).

Standard atmospheric condition


- Ambient temperature Tr: 298k (77°F/25°C)
- Relative air humidity Φr: 30%
- Absolute atmospheric pressure Pr: 100kPa

When actual environmental condition is inconsistent with the condition of output power of the generator set:

- Every 41°F(5°C) of increase in ambient temperature will reduce the power of generator by about 2%.
- Every 30% of increase in relative humidity of air will reduce the power of generator by about 1.5%.
- Every 300 m rising of ASL will reduce the power the generator by about 4.5%.

2 Generator Wiring

- When the generator is connected to household power source as a backup power supply, the connection shall be carried out by a professional electrician or a person familiar with electricity.
- After connecting the load to the generator, check carefully whether electrical connection is safe and reliable. Improper electrical connection may cause generator damage, burning or fire.
- · Avoid connecting this generator to commercial power outlet.
- When extending the cable, be sure not to exceed its length.
- ① 60m cross-section area is 1.5mm²
- 2 100m cross-section area is 2.5mm²
- The appearance of extension cable shall be protected by a layer of tough and elastic rubber cover (IEC25) or other substitutes.

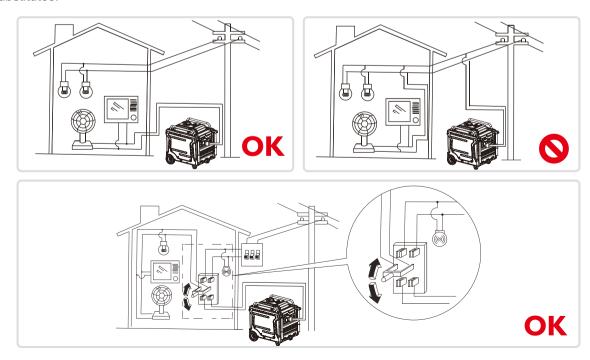

_

USING THE GENERATOR

Connection of AC power



WARNING

All electrical equipment shall be disconnected before inserting the plug.




ATTENTION

- Make sure that all electrical equipment, including wires and plugs, are in good condition before connecting to the generator;
- Make sure that all loads driven by the generator are within rated load range;
- Make sure that load current is within rated current range of rated socket.

Tip: Make sure that the generator set is grounded, and if electrical equipment requires grounding, the generator set must be grounded.

- 1 Start up the engine;
- ② Turn energy-saving switch to "ON";
- 3 Insert the plug into AC outlet;
- 4 Make sure that AC indicator is lit up;
- (5) Switch on electrical equipment.

Tip: Before increasing engine speed, energy-saving switch must be switched to "OFF". If the generator set supplies power to multi loads or electrical equipment, start from large to small according to the size of each electrical equipment.

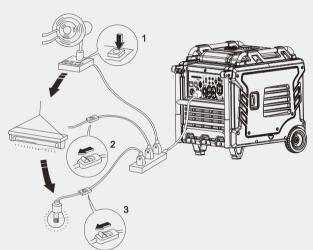

3 Generator Grounding

In order to prevent any damage to the generator caused by electric shock or improper electrical application, it is recommended that the generator is grounded with good conductor with insulating sheath.

- ① Please use grounding wire with sufficient electrical energy capacity;
- 2 Connect one end of grounding wire reliable to grounding bolt on control panel of the generator set;
- ③ Insert grounding body (iron rod with a diameter of 5 ~ 10mm) 200mm below into the earth and lead it out with conductor;
- Connect the other end of the grounding wire reliable to the led wire of grounding body.



Tip: How to change the grounding method please refer to the website: https://www.genmaxpower.com/page/faq



USING THE GENERATOR

Changing the Neutral Point

This generator is "neutral floating" state, if you want to change to a "neutral bonded" state, insert the Bonding Plug into the output socket of the generator to change the neutral floating to neutral bonded status.



Battery Charging

The battery storage time is generally about 6 months. If the generator is not used for a long time, the battery will run out of power. At this time, the battery should be charged. Replace the battery if it is damaged or fails to charge.

Hand start charging: Start the generator by hand, and the battery will be charged automatically when the generator runs.

Use an external power source for charging:

Connect the charger to the battery charging port on the generator panel and connect the mains to charge the battery.







WARNING

Do not start the generator while charging with an external power supply. Keep batteries away from fire sources. Keep the battery in a cool and dry place, away from direct sunlight. Keep batteries away from children.



ATTENTION

1. Charge properly

Keeping battery properly charged and discharged can prolong battery life. Maintaining a power level of 10%-90% in battery is beneficial for battery protection.

2. Choose the appropriate charging temperature

Battery charging temperature range: 32°F~113°F (0°C~45°C).

3. Avoid overcharging

Overcharging of battery must be avoided during the charging process. Overcharging of battery in any form will lead to serious damage to battery performance and even explosion.





Good maintenance and service is the best guarantee for safe, economical and zero-failure operation. It also contributes to environmental protection.

In order to keep the generator in good condition, you must inspect and maintain it regularly. The maintenance schedule is as follows:

Main	tenance cycle	Each	First in 1 month or 20 hours	Then every three months or every 50 hours	100 hours per year or use
	Check-fill	√			
Engine oil	Replace		√	√	
Gearbox gear	Check oil	√			
Oil (if any)	Replace		√	√	
Air cleaner element	Inspection	√			
	Clean		√		
	Replace			√	
Settling cup (if any)	Clean				√
Spark plug	Clean-adjust				√*
Spark eliminator	Clean			√	
Idle speed (if any)**	Check-adjust				√
Valve clearance**	Check-adjust				√
Fuel tank and fuel filter***	Clean				√
Fuel line	Inspection	Every two years (Please replace if necessary)			
Cylinder head, piston	Remove carbon deposit**	Displacement < 225cc, every 125 hours; displacement capacity ≥ 225cc, every 250 hours.			

These items shall be replaced if necessary;

^{**} These items shall be maintained by the dealer authorized by the Company, unless the user has proper tools and maintenance ability.



ATTENTION

- If it often works under high temperature or high load, oil shall be changed every 25 hours;
- If it often works in dusty or harsh environment, air cleaner element shall be cleaned every 10 hours. If necessary, the air cleaner element shall be replaced every 25 hours;
- It shall be maintained on spot-inspection cycle and time, whichever is earlier;
- If maintenance cycle time has elapsed, perform the maintenance as soon as possible as per the table above.



WARNING

Please shut down the engine first before performing any maintenance. The engine shall be placed in a horizontal position. In order to prevent the engine from starting up, separate spark plug cap shall be separated from spark plug.

Do not use it indoors or use it in a tunnel, cave or other places ventilated poorly. Make sure that work area is well ventilated. Exhaust gas from the engine contains toxic gases, carbon oxides, and the inhalation can cause shock, loss of consciousness, and even death.

1 Spark Plug Inspection

Spark plug is an important part of the generator, which must be inspected regularly.

 Remove the left panel cover, and remove the high voltage pack;





2. Insert the screwdriver into the sleeve, to screw it counterclockwise, and then remove the spark plug;



3. Check whether there is discoloration, and remove carbon deposits. Check whether there is little pale to moderate brown on ceramic cores around center electrode of the spark plug;



4. Check the model of spark plug and clearance.

Spark plug gap: 0.7-0.8mm

Standard spark:

BRAND	MODEL
NGK	BPR6ES
TORCH	F6RTC
CHAMPION	RN11YC
BOSCH	WR6DS



Tip: The spark plug clearance is required to be measured by line thickness gauge, which shall be adjusted if necessary.

Install the spark plugs in reverse order of removal.
 Spark plug torque: 22.5±2.5N.m(199±22in-lb)



Tip: If there is no torque wrench when installing the spark plug, a better estimation method is to screw it 1/4-1/2 turns by force after screwing it in place, but the spark plug shall be screwed to specified torque as soon as possible.

2 Adjustment of the Carburetor

The carburetor is an important components of the engine. The adjustment shall be carried out by a dealer with professional knowledge, professional data and equipment, to ensure that the adjustment is proper.

3 Replacement of Oil



WARNING

Do not drain the oil immediately after turning off the generator. Oil temperature is very high, when operating, take care to avoid scalding.

- **1.** Put the generator on a horizontal plane, start the generator, run it for a few minutes to make it warm, then turn off the engine;
- **2.** Open the right exterior cover, find the bolt that put the oil in;





- **3.** 1. Remove the rubber plug;
 - 2. Remove drain oil rubber plug;
 - 3. Use containers to catch waste oil, unscrew the drain oil bolt;
 - Tighten the drain bolt after the waste oil is discharged clean, cover the rubber plug.









4. Unscrew oil dipstick;



5. Refill oil to a proper level, tighten oil dipstick, cover external cover plate and tighten the knob.

Recommended oil: SAE S10W/30







Oil Filter

It is recommended to clean the oil filter after the first operation of the generator. After that, it will be cleaned every 50 hours.

1. Drain the oil from the engine as in the previous oil drain change procedure, and then remove the oil filter next to it;



- 2. 1. Clean the impurities inside the filter plug. If the impurities are too much to clean, use detergent to clean;
 - 2. After cleaning, blow dry with compressed air or air dry naturally and put back in the original position.



Air Filter

Dirty air cleaner may prevent air from flowing into the carburetor. In order to prevent failure of the carburetor, please maintain air cleaner regularly. If being used in a dusty environment, it shall be maintained frequently.

1. Remove screws, to remove cover plate of air cleaner;





2. Clean foam cleaner element with cleaning solvent and blow it dry, Put a few drops of oil on the filter element.



ATTENTION

Be sure not to twist the foam cleaner element forcibly to avoid damage.



3. Put foam cleaner element into air cleaner;

Tip: Make sure that the surface of foam cleaner element is in close contact with air cleaner, and there shall be no gap leaking air. Be sure not to start the engine before air cleaner is assembled, because it will generate excessive toxic gas and wear the cylinder;



4. 1. Reassemble empty air cleaner cap back to original position, and tighten screws:

2. Assemble left outer cover and tighten bolts.



6 Fuel Filter Screen



WARNING

Be sure not to open fuel tank of the generator in a place where smoking or with flame.

- 1. Remove fuel tank cap and fuel tank filter screen.
- 2. Clean fuel tank filter screen with gasoline.
- 3. Wipe filter screen dry, and put it back into fuel tank.
- 4. Reassemble fuel tank cap.







ATTENTION

Be sure to screw fuel tank cap tight.

STORAGE AND TRANSPORT

1 Generator Storage

If it is stored long-term, in order to prevent aging, you shall take some storage measures.

- 1. Shut down generator.
- **2.** Open fuel tank cap, to take out fuel filter screen. Pump all fuel in fuel tank into special fuel tank, and then reassemble fuel tank cap back.





3. Start up the engine to burn off fuel in the carburetor, and then shut it down.

Tip: Do not connect any electrical equipment. Running time of the engine depends on remaining fuel in the fuel tank.

4. Open generator left exterior cover and enter carburetor. Locate the clear plastic hose from the carburetor and place a suitable container under it to capture the drained fuel.



5. Loosen the carburetor drain screws until you see fuel draining from the carburetor.



6. Allow fuel to drain into the container and tighten the drain screws on the carburetor. Install the engine service panel.



 Unscrew oil dipstick, and drain oil in the crankcase off. Fill new oil to upper oil limit, and then assemble oil dipstick.

STORAGE AND TRANSPORT

8. Gently pull startup handle until you feel resistance, allowing both inlet valve and exhaust valve to be closed.



9. Disconnect the battery cable.



10. Place the generator set in a clean and dry area.

2 Generator transport

- When the generator set is transported, it shall be ensured that there is no fuel spilling;
- Do not fill excessive fuel into fuel tank;
- Do not run the generator, and avoid direct sunlight;
- Do not transport the generator set on rough road for long time.

3 Preparation for Use After Storage

- 1. Slowly pull the starter cord a few times to clean oil from the cylinder or to eject any pump protector from the pump which may have been added prior to storage.
- 2. Remove the spark plug from the cylinder. Wipe oil from the spark plug and return it to the cylinder and retighten.
- 3. Reconnect the spark plug wire.
- 4. Refuel engine per earlier instructions in this manual.

TROUBLESHOOTING

Problem	Possible Causes	Probable Solutions
Engine will not start	FUEL RELATED:	FUEL RELATED:
	No fuel in tank or fuel valve closed.	Fill fuel tank with fresh 87+ octane stabilizer-treated unleaded gasoline and open fuel valve. Do not use gasoline with more than 10% ethanol (E15, E20, E85, etc.).
	2. Choke not in START position, cold engine.	2. Move Choke to START position.
	3. Gasoline with more than 10% ethanol used. (E15, E20, E85, etc.)	3. Clean out ethanol rich gasoline from fuel system. Replace components damaged by ethanol. Use fresh 87+ octane stabilizer-treated unleaded gasoline only. Do not use gasoline with more than 10% ethanol (E15, E20, E85, etc.).
	4. Low quality or deteriorated, old gasoline.	4. Use fresh 87+ octane stabilizer-treated unleaded gasoline. Do not use gasoline with more than 10% ethanol (E15, E20, E85, etc.).
	5. Carburetor not primed.	5. Pull on Starter Handle to prime.
	6. Dirty fuel passageways.	Clean out passageways using fuel additive. Heavy deposits may require further cleaning.
	7. Carburetor needle stuck. Fuel can be smelled in the air.	7. Gently tap side of carburetor float chamber with screwdriver handle.
	Too much fuel in chamber. This can be caused by the carburetor needle sticking.	Turn Choke to RUN position. Remove spark plug and pull the start handle several times to air out the chamber. Reinstall spark plug and set Choke to START position.
	O. Classed Fuel Filter	9. Replace Fuel Filter.
	9. Clogged Fuel Filter.	LONITION (ODADIC) DELATED
	IGNITION (SPARK) RELATED:	IGNITION (SPARK) RELATED:
	Power Switch at OFF position.	1. Turn Power Switch to ON.
	Spark plug cap not connected securely.	2. Connect spark plug cap properly.
	3. Spark plug electrode wet or dirty.	3. Clean spark plug.
	4. Incorrect spark plug gap.	4. Correct spark plug gap.
	5. Spark plug cap broken.	5. Replace spark plug cap.
	6. Circuit breaker tripped (electric start models only).	6. Reset circuit breaker. Check wiring and starter motor if breaker continues to trip.
	Incorrect spark timing or faulty ignition system.	Have qualified technician diagnose/ repair ignition system.
	COMPRESSION RELATED:	COMPRESSION RELATED:
	Cylinder not lubricated. Problem after long storage periods.	Pour tablespoon of oil into spark plug hole. Crank engine a few times and try to start again.
	Loose or broken spark plug. (Hissing noise will occur when trying to start.)	Tighten spark plug. If that does not work, replace spark plug. If problem persists, may have head gasket problem, see #3.
	Loose cylinder head or damaged head gasket. (Hissing noise will occur when trying to start.)	Tighten head. If that does not remedy problem, replace head gasket.
	Engine valves or tappets mis-adjusted or stuck.	Have qualified technician adjust/ repair valves and tappets.
	ENGINE OIL RELATED:	ENGINE OIL RELATED:
	1. Low engine oil.	Fill engine oil to proper level. Check engine oil before EVERY use.
	Engine mounted on slope, triggering low oil shutdown.	2. Operate engine on level surface. Check engine oil level.
	SPARK ARRESTOR RELATED:	SPARK ARRESTOR RELATED:
	Spark Arrestor clogged with soot.	Clean and replace Spark Arrestor.



Follow all safety precautions whenever diagnosing or servicing the generator or engine.

TROUBLESHOOTING

Problem	Possible Causes	Probable Solutions
Engine misfires	Spark plug cap loose.	Check cap and wire connections.
	Incorrect spark plug gap or damaged spark plug.	2. Re-gap or replace spark plug.
	Defective spark plug cap.	Replace spark plug cap.
	4. Old or low quality gasoline.	4. Use only fresh 87+ octane stabilizer-treated
		unleaded gasoline. Do not use gasoline with more than 10% ethanol (E15, E20, E85, etc.).
	5. Incorrect compression.	Diagnose and repair compression. (Use Engine will not start: COMPRESSION RELATED section.)
Engine stops suddenly	Carbon Monoxide level high. Red light on Carbon Monoxide Sensor illuminates.	Leave area immediately and allow area to ventilate thoroughly. Only operate generator outside.
	CO Sensor Alarm flashes yellow continually shortly after starting.	Carbon monoxide sensor malfunction. Sensor needs service. Do not use the Generator until the sensor is working properly.
	CO Sensor Alarm flashes yellow continually after longer period of operation.	Make sure to operate generator within rated ambient temperature; maintain minimum 5 ft. clearance from all sides.
	4. Low oil shutdown.	Fill engine oil to proper level. Check engine oil before EVERY use.
	Fuel tank empty or full of impure or low quality gasoline.	 Fill fuel tank with fresh 87+ octane stabilizer treated unleaded gasoline. Do not use gasoline with more than 10% ethanol (E15, E20, E85, etc.).
	6. Defective fuel tank cap creating vacuum, preventing proper fuel flow.	6. Test/replace fuel tank cap.
	7. Faulty magneto.	7. Have qualified technician service magneto.
	Disconnected or improperly connected spark plug cap.	8. Secure spark plug cap.
Engine stops when	Dirty air filter	Clean element.
under heavy load	2. Engine running cold.	2. Allow engine to warm up prior to operating equipment.
Engine knocks	Old or low quality gasoline.	Fill fuel tank with fresh 87+ octane stabilizer-treated
	Engine overloaded.	unleaded gasoline. Do not use gasoline with more than
	Incorrect spark timing, deposit	10% ethanol (E15, E20, E85, etc.).
	buildup, worn engine, or other mechanical problems.	2. Do not exceed equipment's load rating.
	meenamear problems:	3. Have qualified technician diagnose and service engine.
Engine backfires	Impure or low quality gasoline.	Fill fuel tank with fresh 87+ octane stabilizer-treated unleaded gasoline. Do not use gasoline with more than 10% ethanol (E15, E20, E85, etc.).
	2. Engine too cold.	Use cold weather fuel and oil additives to prevent backfiring.
	3. Intake valve stuck or overheated engine.	3. Have qualified technician diagnose and service engine.
	4. Incorrect timing.	4. Check engine timing.
Attached device doesn't have power	Device not plugged in properly.	Turn off and unplug the device, then plug it back in again and turn on.
	2. Circuit Breaker tripped.	Turn off and unplug device, reset Circuit Breaker, plug in device and turn on.
	Product needs service.	Have product repaired.
Attached device begins to operate abnormally	Problem with device.	Immediately unplug device. Have device repaired by a qualified technician, or replace device.
	Rated load capacity exceeded.	Lower the number of items plugged into the generator to stay within the rated capacity, or use a more powerful generator.



Follow all safety precautions whenever diagnosing or servicing the generator or engine.

TECHNICAL PARAMETERS

Item	GM11000iET
Rated Power (kW)	8.5(GAS.)/8.0(LPG)/6.8(NG)
Max. Power (kW)	11(GAS.)/9.5(LPG)/8.4(NG)
Engine Model	460i
Valve Clearance	Input valve:0.10~0.15 mm, Output valve:0.15~0.20 mm
Stroke × Bore (mm)	92×69
Engine Type	4-stroke
Displacement (cc)	458
Gas Distribution Mode	OHV
Cooling Mode	Forced cooling wind
Rated Speed (RPM)	3600
Starting Method	Recoil start/Electrical start/Remote start
Fuel Tank Volume (gal)	6.9(26L)
Fuel Type and Grade	Vehicle-use unleaded gasoline
Lubricating Oil Capacity (gal)	0.3(1.1L)
Lubricating Oil Model	SAE 10W/30
Noise dB (at 7m)(25% load)	62
Rated Voltage (V)	120/240
Rated Frequency (Hz)	60
Rated Power Factor	1
Phase Number	Single phase
Run Time @ 25% (h)	14
Fuel Consumption Rate (25% load)(L/h)	2.195
Fuel Consumption Rate (100% load)(L/h)	5.9
LPG Consumption Rate (25% load)(kg/h)	1.65
LPG Consumption Rate (100% load)(kg/h)	3.43
NG Consumption Rate (25% load)(m³ /h)	1.296
NG Consumption Rate (100% load)(m³ /h)	3.27
THD	≤3%
Overall Dimension (in.)	30.9×22.6×29.3(785×575×745mm)
Net Weight (lb.)	247(112kg)



CHOOSING A GENERATOR

OUICK REFERENCE WATTAGE Starting Watts Power Rating Tool or Appliance Blender 300 650 2800 귕 500 Coffee Maker 1500 Drill 600 900 Т 200 Fan 3800 8 2 1000 Furnace 1/4 hp 600 000 Game console 150 Hand sander 600 1200 Running **Running Watts** Hedge trimmer 450 1200 Running Watts 100 Lamp 800 Laptop LED/LCD TV 150 Watts Microwave 1000 Modem/router 20 Paint sprayer 600 600 Radio 100 200 200 Slow cooker String trimmer 350 875 800 1300 Sump Pump 1/3 hp 1000 Work light Belt sander 1200 2400 2400 Chainsaw 1200 Circular saw 1200 2000 2400 Edger 950 Electric grill 1650 1200 2400 Lawn mower 1200 2400 Pressure washer 700 2200 Refrigerator 2250 Washing machine 1150 Well pump 1000 2100 Window AC 13k BTU 1800 2800 Air compressor 1 hp 1600 4500 7200 Central AC 3 ton 5400 **Electric Dryer** 5400 6750 3400 6500 **Heat Pump 3 ton** Water heater 4000 †Chart for reference only. Check your device for ACTUAL wattage requirements.

HOW TO CALCULATE

Running Watts needed: Total Running Watts of ALL items

to be powered by the generator.

Starting Watts needed: Add highest SINGLE Starting Watt to Total Running Watts needed above.

EXAMPLE

1 Calculate Running Watts:

Furnace 600
Lamp 100
Microwave 1000
Refrigerator 700

Total Running Watts 2400

2 Calculate Starting Watts:







In production management, based on orderly, efficient, scientific principles. trying to do as better as possible in product design, development, production, inspection, etc. to make our production can keep orderly. And will continue to make improvement to make sure that keep the competitiveness.

Welcome friends at home and abroad to visit and guide, work together to create brilliant.



Caojie Industrial Park, Hechuan District, Chongqing

Phone 866-960-2920

E-mail service@genmaxpower.com

Http://www.genmaxpower.com









Linkedin

YouTube







